

Corporate Yard Reservoirs

Department of Public Works




West reservoir was built in 1970. East reservoir was built in 1978. Both reservoirs possess a 6-million-gallon capacity.




Water Meters



Top: New meters Bottom: Old, non-registering meters

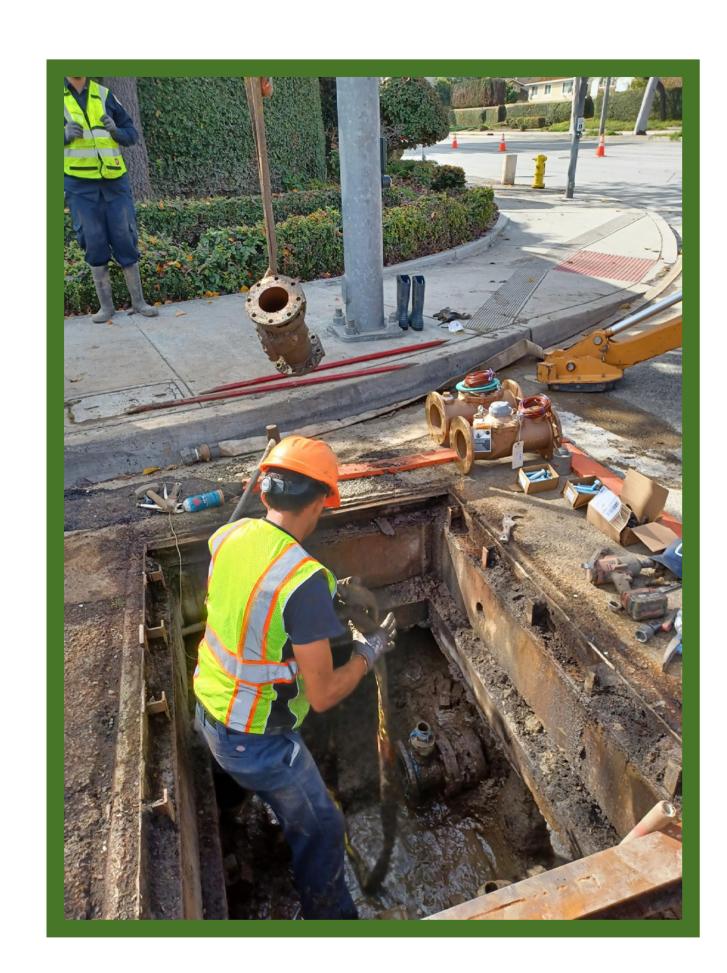

Replacement of two 6-inch meters

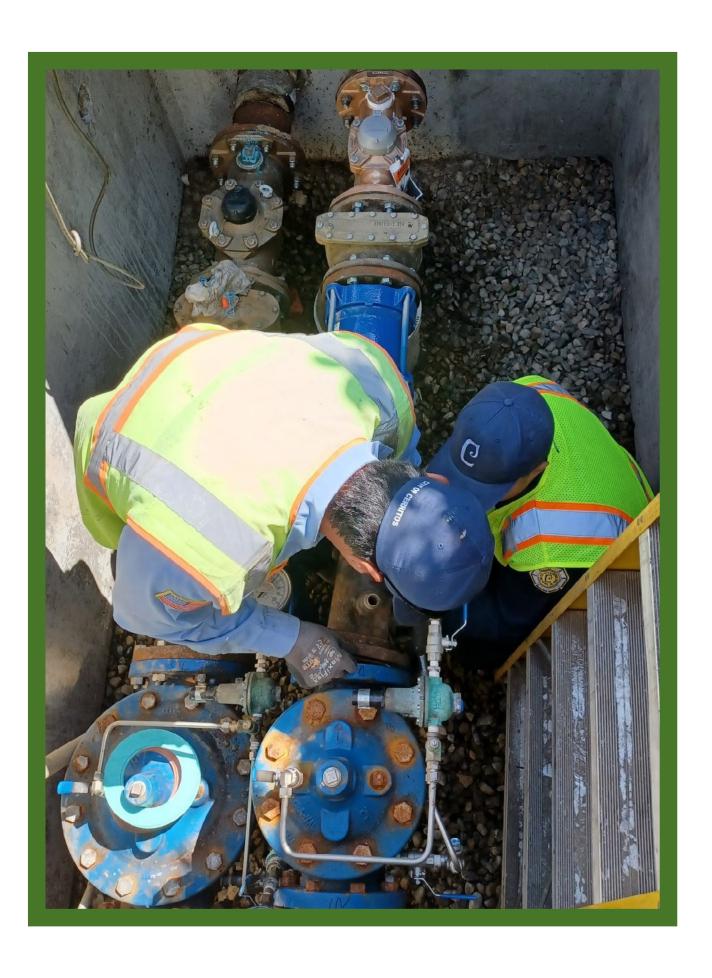

Replacement of 4-inch meter at the Norwalk interconnection



Replacement of meter and angle meter stop at a residence




Well Maintenance



C-2 Well Pump



Equipment needed to clean well

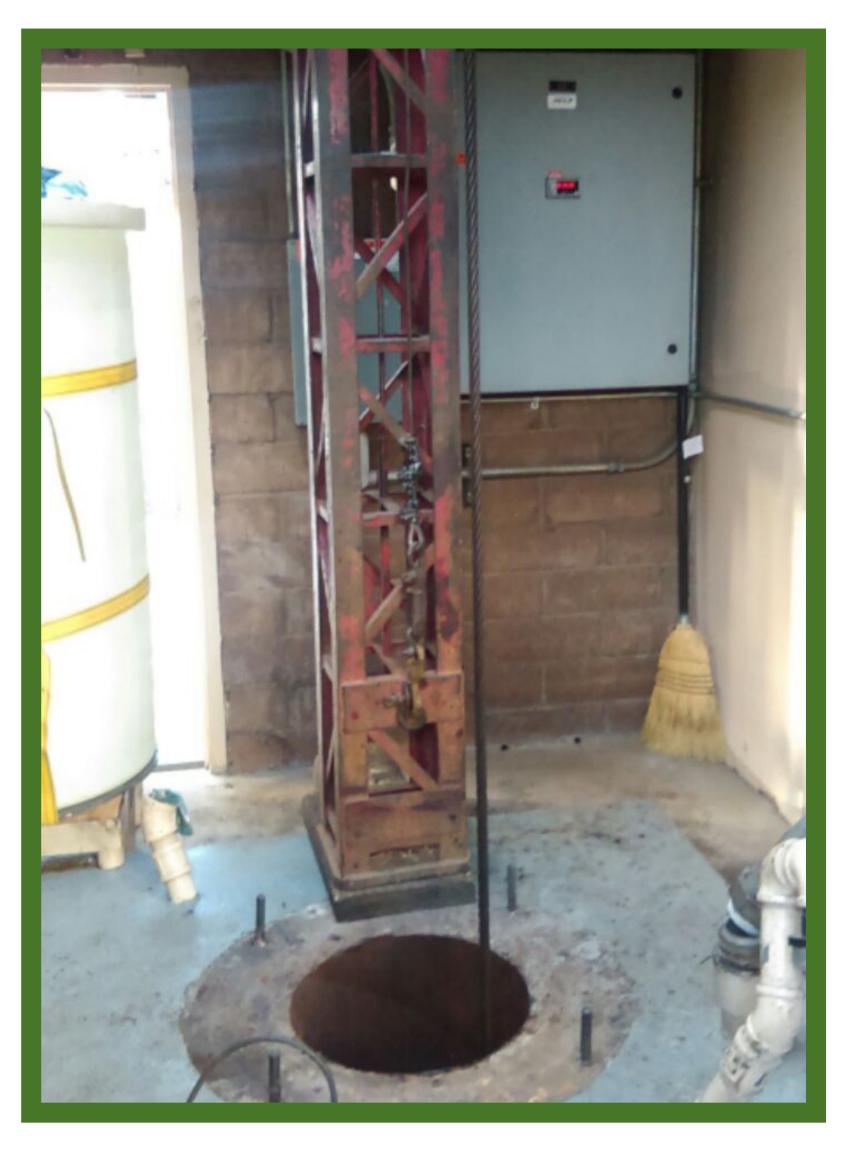


Pump removed for well cleaning




Scrubber Brush




Water Mains and Appurtenances

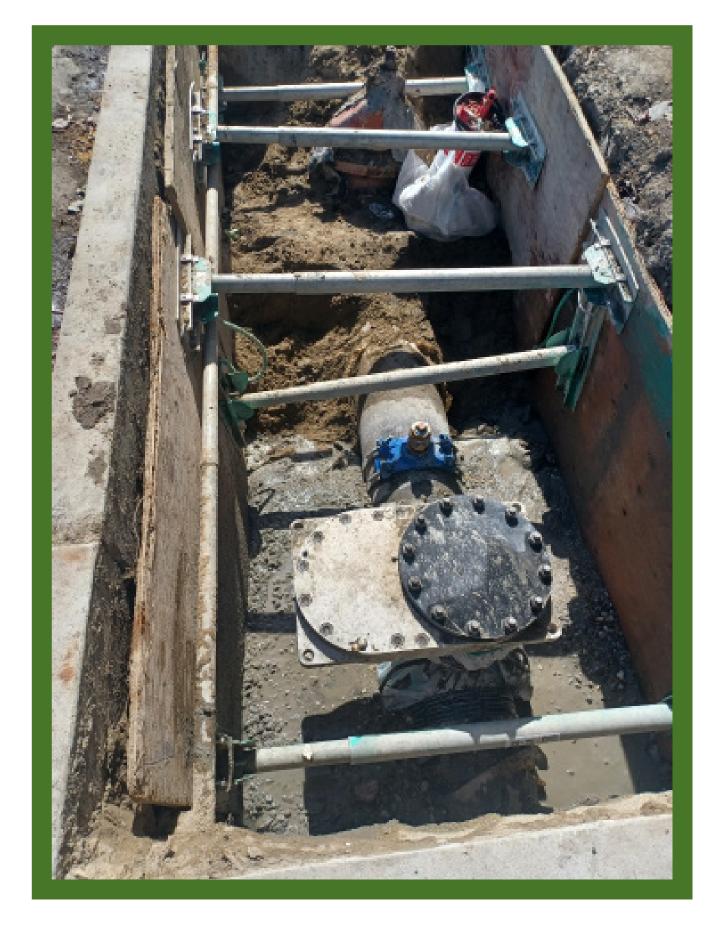

Water meter replacement (interconnection to other cities)

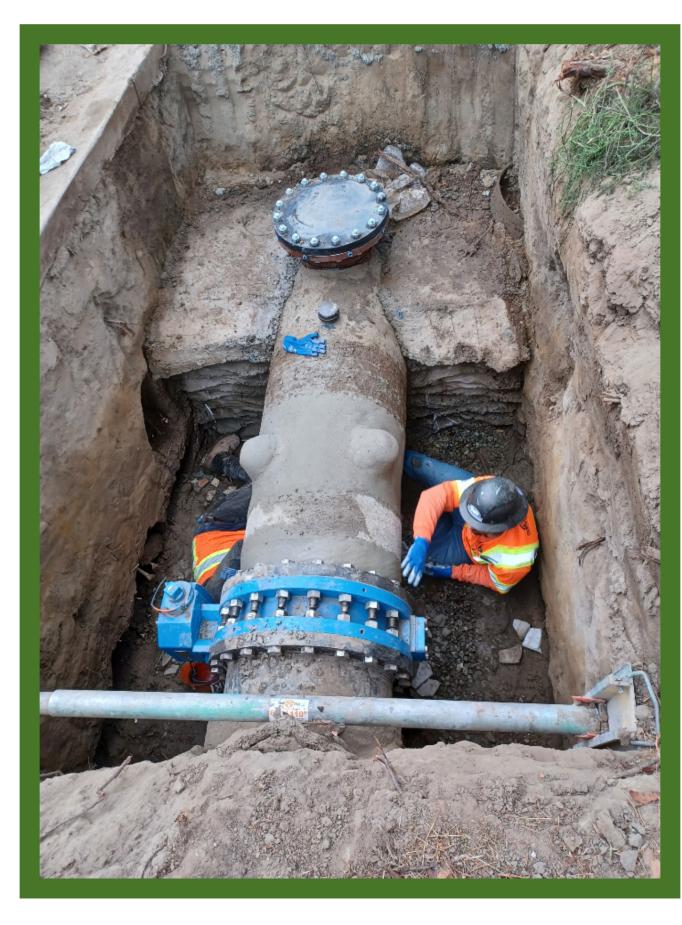

Replacement of water main valves

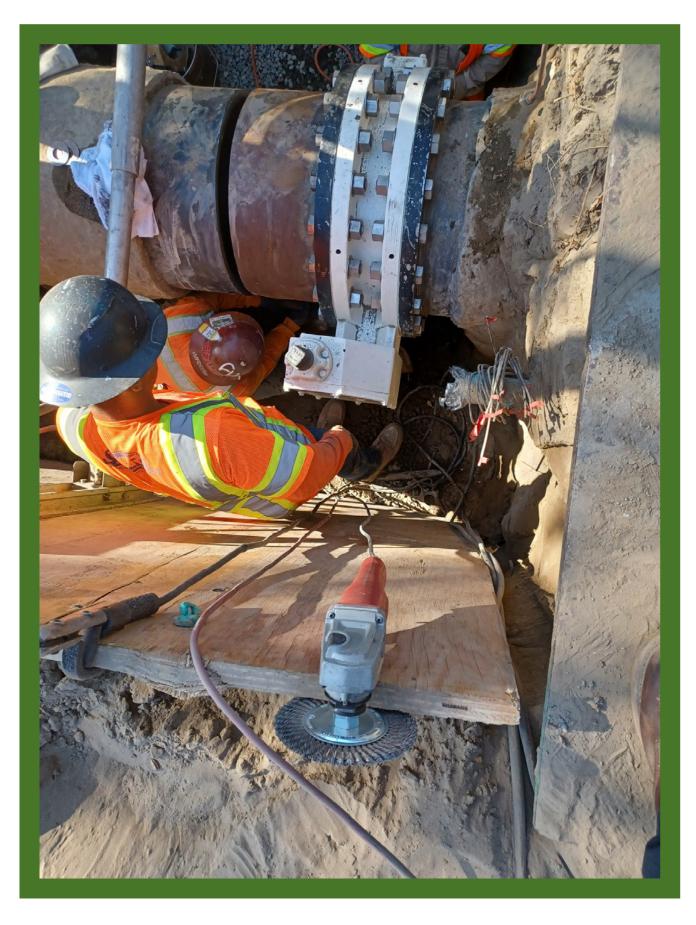

Replacement of 24-inch water main valve



Water pump testing at well




Water Mains and Appurtenances




Corroded water shutoff valve in need of replacement



Pressure relief valve in need of replacement (ceased)

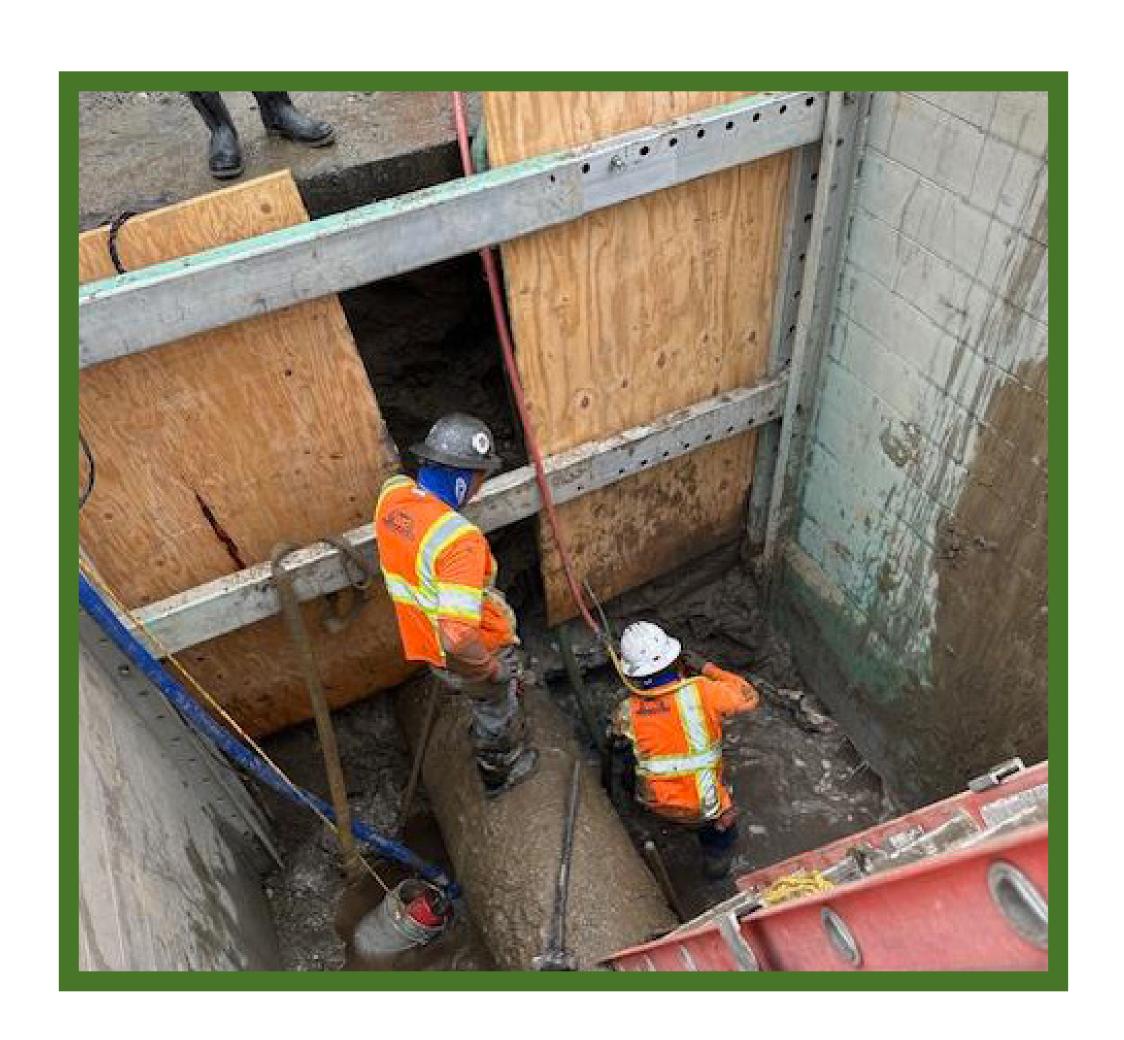

Leak repair of 24-inch transmission line

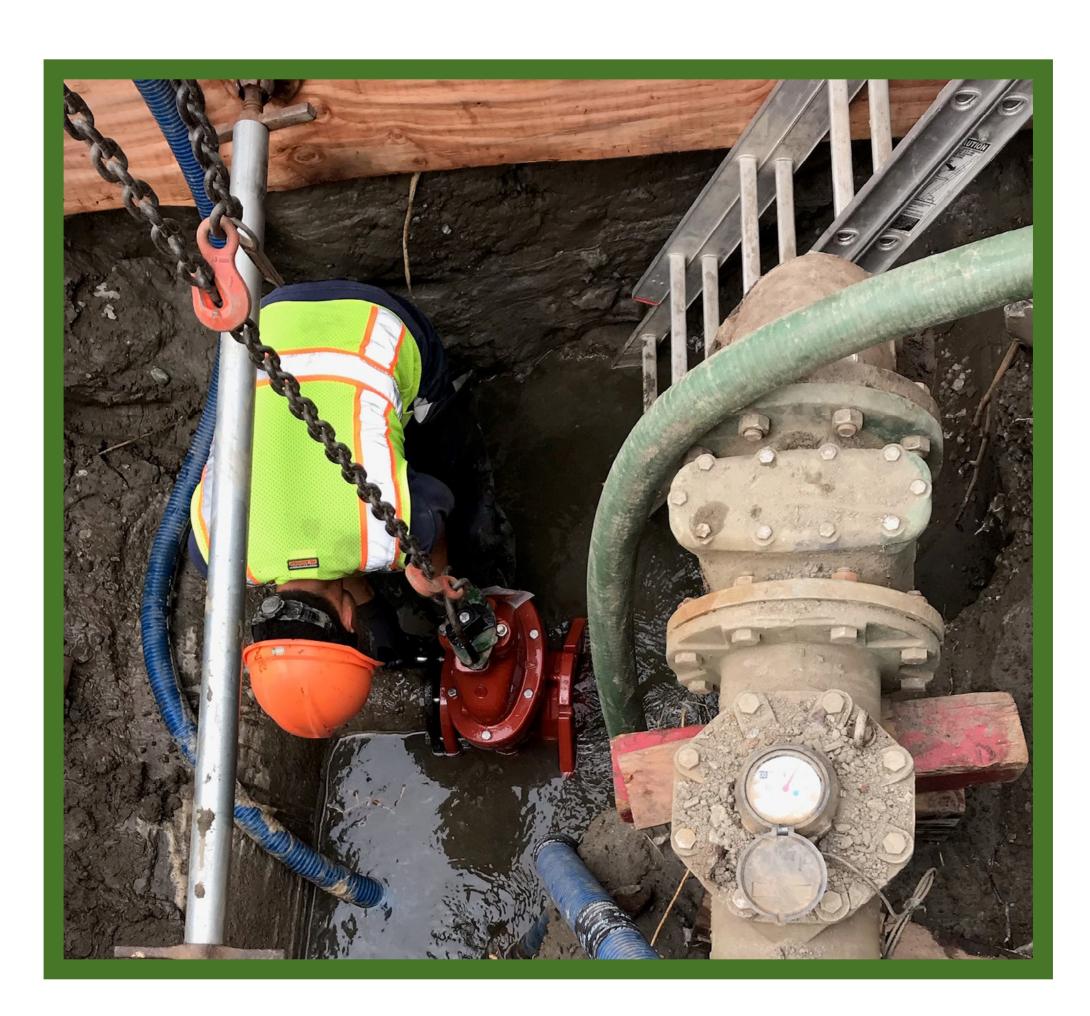

Replacement of 6-inch water valve



Water Main Lines and Water Wells

